


# Solid bottom panels

Closed circuit cooling towers

## Options and accessories

### Solid bottom panels

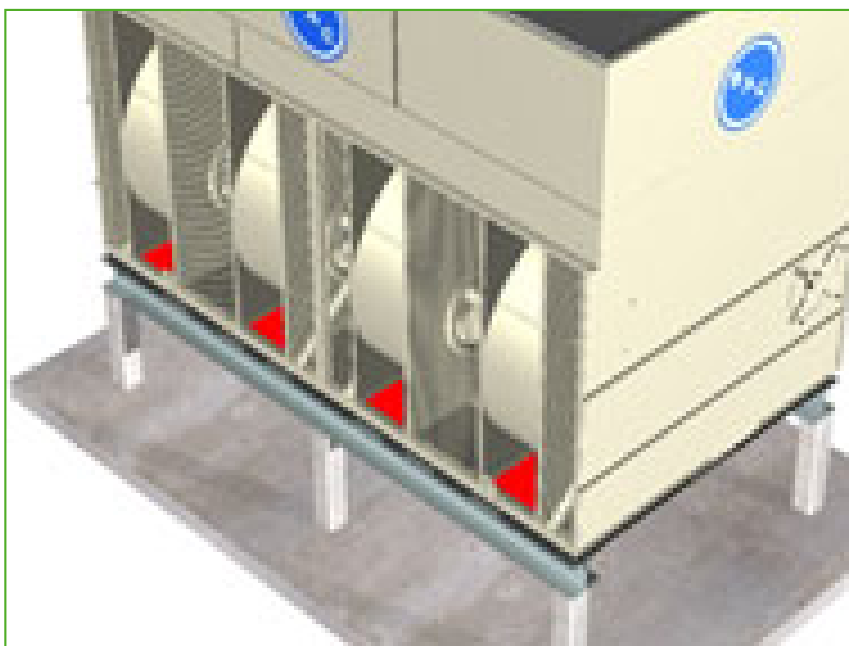

Solid bottom panels are required when the unit is installed elevated by 30 cm or more and when intake air is ducted to the unit.

#### Factory-installed solid bottom panels

- ensure safe operation by providing protection from moving parts like sheaves, belts, motors, fan wheels, shafts,...
- ensure optimal performance by preventing bottom air from being drawn into the unit, thereby avoiding motor overloads

For more information on solid bottom panels, contact your [local BAC representative](#).